



## User Manual



Gas Detector

**Teta EcoWent / Teta EcoN**

Product code: PW-105-CO / PW-111-NO2



Reliable and Innovative **Gas Detection & Safety Systems**

We design, manufacture, implement and support:  
**Systems for Monitoring, Detection and Reduction of gas hazards**








For more details please visit our website [www.atestgaz.pl](http://www.atestgaz.pl)

**Atest Gaz A. M. Pachole sp. j.**  
ul. Spokojna 3, 44-109 Gliwice  
Poland


tel.: +48 32 238 87 94  
fax: +48 32 234 92 71  
e-mail: [contact@atestgaz.pl](mailto:contact@atestgaz.pl)

[www.atestgaz.pl](http://www.atestgaz.pl)

## Remarks and reservations


-  Read and understand this manual prior to connection and operation of the device. Keep the User Manual with the device for future reference.
-  The manufacturer shall not be held responsible for any errors, damage or defects caused by improper selection of suitable devices or cables, errors in installation of equipment or any misuse due to failure to understand the document content.
-  Unauthorised repairs and modifications of the device are not allowed. The manufacturer shall discard any responsibility for consequences of such actions.
-  Exposure of the device to the impact of excessive mechanical, electric or environmental factors may lead to damage of the device.
-  Operation of damaged or incomplete devices is not allowed.
-  Engineering of a Gas Safety System for any specific facilities to be safeguarded may need consideration of other requirements during the entire lifetime of the product.
-  Use of unauthorized spare parts different from the ones listed in Table 6 is strictly forbidden.

## How to use this manual?

-  Important fragments of the text are highlighted in the following way:



Pay extreme attention to information provided in such framed boxes.

-  This User Manual consists of a main text and attached appendices. The appendices are independent documents and can be used separately from this Manual. Page numbering of appendices starts anew with no relationship to page numbering of the main document and appendices may have their own tables of contents. In the right bottom corner of each page you can find the name (symbol) of any document included into the User Manual package with its revision (issue) number.

## Table of contents

<b>1 General information.....</b>	<b>5</b>
1.1 Application field.....	5
1.2 Operation principle.....	5
<b>2 Safety.....</b>	<b>7</b>
<b>3 Device design.....</b>	<b>8</b>
<b>4 Input-output interfaces.....</b>	<b>8</b>
4.1 Electric interface.....	8
<b>5 User interface.....</b>	<b>9</b>
5.1 Indication of the device status.....	9
5.2 Display.....	10
<b>6 System architectures.....</b>	<b>11</b>
6.1 Data bus architecture.....	11
<b>7 Lifetime cycle.....</b>	<b>12</b>
7.1 Transportation.....	12
7.2 Installation.....	12
7.3 Mechanical mounting of detectors.....	12
7.4 Commissioning of the gas monitoring system.....	14
7.5 Device configuration.....	14
7.6 Troubleshooting.....	15
7.7 Maintenance schedule.....	16
7.8 Disposal.....	19
<b>8 Technical specification.....</b>	<b>19</b>
<b>9 List of fast wearing parts.....</b>	<b>20</b>
<b>10 List of accessories.....</b>	<b>20</b>
<b>11 Marking codes of products.....</b>	<b>20</b>
<b>12 Appendices.....</b>	<b>21</b>

## List of Tables

Table 1: Electric connections.....	9
Table 2: Indication of the gas detector operation modes.....	10
Table 3: Types of suitable cables.....	13
Table 4: Possible reasons for error signals.....	16
Table 5: Technical specification.....	20
Table 6: List of fast wearing parts.....	20
Table 7: List of accessories.....	20
Table 8: Specification of marking codes for gas detectors.....	20

## List of Figures

Figure 1: Layout of device components and its dimensions.....	8
Figure 2: User interface.....	9
Figure 3: Arrangement of gas detectors according to the data bus architecture.....	11
Figure 4: An example of cable termination inside a gas detector.....	13

## 1 General information











### 1.1 Application field

Gas Detectors Teta EcoWent and Teta EcoN are designed as crucial components of the Teta Gas system for monitoring of hazardous gas concentrations and are dedicated to detect excessive (hazardous) concentrations of carbon oxide and nitrogen dioxide in surrounding atmosphere (e. g. in underground garages and car parks).



Teta EcoWent and Teta EcoN gas detectors are not designed for operation in areas with potentially explosive atmospheres.

#### Key features of gas detectors:

-  Power supply and data transmission via a single two-core cable.
-  Safe installation with low power supply voltage of any polarization.
-  Easy assembling and networking.
-  Possibility to couple with the Teta MiniDet gas detector and to set up a pair of collaborating devices for combined detection of CO and LPG concentrations.
-  Simple and clear procedure to assign and verify addresses of individual detectors within a gas monitoring network.
-  Possibility to verify status of individual detectors by means of the supervising control unit.
-  Optional calibration of the detector parameters by replacement of the detector PCB (electronics board) – very short time of calibration.
-  Three configurable alarm thresholds that trigger when a specified concentration is exceeded.
-  Option to adjust the averaging time for alarm thresholds 1 and 2, and the delay time for alarm threshold 3.
-  Indication of detector faults.

### 1.2 Operation principle

Gas detectors are crucial components of any system for gas detection. They are designed for periodical measurements of gas concentration in ambient air. Information that the settings for concentration thresholds are exceeded is shown by means of dedicated light indicators (LEDs) provided on the side wall of the detector housing (see Figure 1) and transmitted via a digital output line.

Presence of hazardous gases is detected by means of electrochemical sensors. Such a solution enables high insensitivity to variations of ambient conditions, such as temperature, humidity or pressure. The sensor also distinguishes with high immunity to presence of disturbing chemical compounds (e.g. methane, isobutene or carbon dioxide), which eliminates occurrence of faked alarms.


The sensor applied in our detectors demonstrates slight sensitivity to hydrogen and fumes vapours of ethanol, but for typical applications such gases occur only sporadically and in small amounts. Please refer to Appendix [2] for more details about electrochemical sensors.



Types of monitored gas and tripping thresholds are specified in its calibration certificate.

Teta EcoWent / Teta EcoN detectors can directly collaborate with Teta MiniDet devices (by direct coupling by means of X2 terminal) and make up a paired unit that enables simultaneous detection of carbon monoxide (CO) and LPG (C<sub>3</sub>H<sub>8</sub> and C<sub>4</sub>H<sub>10</sub>)<sup>1</sup>.

Operation of gas detector consists in periodical measurements of hazardous gases in their vicinity with continuous averaging of measurement results. Momentary concentration of gases are measured with the time period of 1 second and average concentrations are calculated. These measurements enable reporting of warnings or alarms.

 for CO/NO<sub>2</sub>:

- Alarm 1 or Alarm 2 is raised against the average concentrations of hazardous gases (set for a specific averaging time, possible values range from 0 to 60 minutes),
- Alarm 3 is reported when the momentary concentration exceeds the threshold limit for a specified time period (delay time, possible values ranging from 0 to 15 minutes),

 for LPG:

- Conditions for Alarm 1 and Alarm 2 are established against average concentration (set for a specific averaging time, possible values range from 0 to 60 minutes),
- Alarm 3 is generated when any momentary concentration exceeds the threshold limit for a specified time period (delay time, possible values ranging from 0 to 15 minutes).



Information on the default alarm thresholds, averaging times, and delay times can be found in Table 5.

Depending on results of the foregoing actions the system may adopt various statuses that are described in subsequent paragraphs.

### 1.2.1 Operation

It is the status when the gas detector is in sound working conditions and takes regular measurements.


Measurement results for the monitored gas still remain below threshold limits and no irregularities in operation of the equipment are detected. The detector needs no particular attention of personnel beside:

-  regular and frequent verification of indications, preferably under daily basis,
-  periodical inspection and calibration (see Section 7.7.1).

### 1.2.2 Alarm 1 (threshold 1) / Alarm 2 (threshold 2)

It is the device status when only slight concentrations of hazardous gases are detected and advising the personnel is needed.

Under such circumstances the operator should undertake the following actions:

-  check possible reasons that may include:
  - appearing of gas in facilities monitored by the system,
  - interference of the detector operation by foreign substances (e.g. solvents of high concentration or fuel fumes) – such substances must be expelled from monitored facilities,
  - offset of the characteristic curve – as the times goes by the detector tend to drift with an offset of the null point. Therefore detectors must be regularly calibrated, otherwise the alarm thresholds (for Alarm 1 or Alarm 2) may offset to the area of pure air, i.e. the situation when competent inspectors have checked by means of appropriate instruments that no gas or interfering substances are present at the facilities.

<sup>1</sup> Detectors are calibrated with the use of gaseous propane C<sub>3</sub>H<sub>8</sub>.

### 1.2.3 Alarm 3 (threshold 3)

This status is activated when concentration of hazardous gases exceeds the third threshold for a period longer than the delay time. If so, the necessary actions shall include:

- evacuation of third persons from the endangered area,
- if possible, enable ventilation of endangered confined spaces, e.g. open windows and doors (unless the control unit automatically switched the ventilation system on).

### 1.2.4 Failure

In parallel to measurements of gas concentration the detector carries out a series of self-test measurements to verify fault-free operation of the sensor and the gas monitoring system as a whole.

The defects indicated by the gas detectors may include:

- problems with built-in gas sensors,
- error of communication with the control unit,
- incorrect configuration,
- interrupted /broken connection with the Teta MiniDet detector.

### 1.2.5 Warm-up

After power on the detector need some time to stabilize operation parameters of sensors. It is the time period when no measurements are taken. Such a warm-up procedure takes about two minutes and the detector starts normal operation.

## 2 Safety



Do never install gas detectors at locations exposed to direct effect of water (moisture) or direct sunlight.



When defects are revealed switch the detector off, secure connection cables and contact maintenance staff or a service team.



All activities related to connecting detectors must be carried out while Control Unit's power supply is off.



Despite the power supply voltage for the Gas Safety System is off, dangerous voltage may persist across terminals of the Control Unit. Such a voltage may come from another system controlled by the same unit, for instance ventilation, that use one output pin of the Control Unit.



The gas detector must be reliably secured during any repair, installation or maintenance works.



Before painting the facility walls and floor make sure that the device is properly secured against unintentional painting or paint splashing.



Before use of silicon or silicon-based materials (paints, adhesives, sealant, etc.), make sure that the device is properly secured against unintentional coating.

### 3 Device design

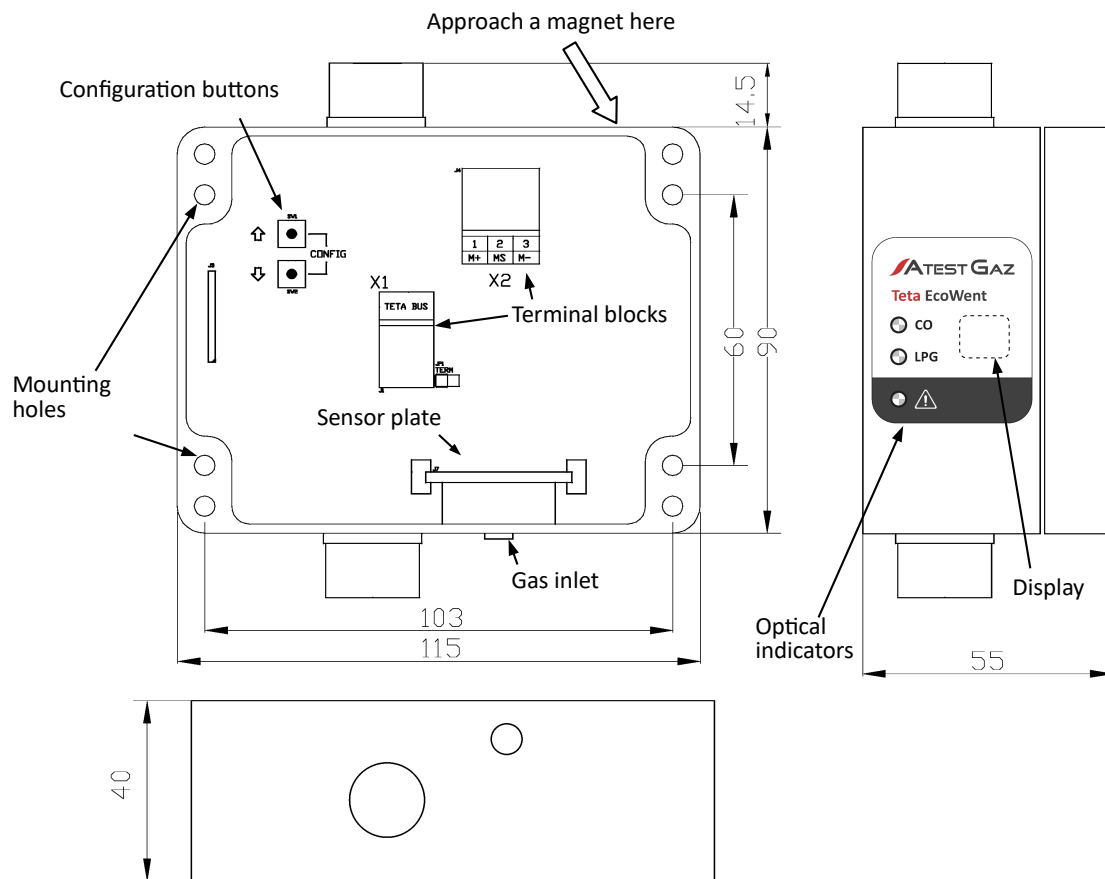


Figure 1: Layout of device components and its dimensions

## 4 Input-output interfaces

### 4.1 Electric interface

Locations and arrangement of terminal blocks is shown on Figure 1.

Port designation	Name	Terminal	Description
X1	TETA BUS		Teta Bus port. Parameters – see Section 8
			Supply / data transmission line
X2			Port for connection of the Teta MiniDet Gas Detector
	M+	1	Positive
	MS	2	Signal line
	M-	3	Negative

Table 1: Electric connections

## 5 User interface

### 5.1 Indication of the device status

Gas detectors are provided with three LED indicators to show status of the device. These LEDs are located on the side wall of the device housing (see Figures 1 and 2).




Figure 2: User interface

Table 2 summarizes how status of the gas detector is indicated by means of individual LEDs. Detailed description of possible operation status is provided in Section 1.2.

LED indicator	LED indication	Operation mode
CO / NO <sub>2</sub>	2	Regular operation of the detector, gas concentration below the established thresholds
		Alarm 1
		Alarm 2
		Alarm 3
		Failure of the measuring path for CO or NO <sub>2</sub> , incorrect connection
		Warm-up of the measuring path for CO or NO <sub>2</sub>
	3 cycles 1 cycle	Significant exceeding of the sensor range

2 G – green, Y – yellow, R – red.









LED indicator	LED indication	Operation mode
LPG		Regular operation of the detector, gas concentration below the established thresholds
		Alarm 1
		Alarm 2
		Alarm 3
		Failure of the measuring path for LPG, incorrect connection, configuration error or defect of the coupled Teta MiniDet detector
		Warm-up of the measuring path for LPG
		No requests from the control unit
		Internal defect of the gas detector (no relation to the measuring paths)



Table 2: Indication of the gas detector operation modes

## 5.2 Display

The side wall of the device housing comprises also a display module (see Figure 1). The display panel is designed to show information that is explained in subsequent sections.

### 5.2.1 Detector address

The detector address can be displayed with no need to open the device housing, it is just enough to approach a permanent magnet to a specific location on the housing (this location is shown in Figure 1). Depending on the operation mode of the detector the following details are displayed:

-  regular operation of the detector – the display presents sequentially the detector address ‘Ad’, its setting and ‘tE’,
-  failure or warm-up – the sequence of address ‘Ad’ and setting.

The device address can be also displayed by means of configuration buttons.

### 5.2.2 Information about test / simulation

#### 5.2.2.1 Test with gas

A gas test allows you to quickly check that the gas detector is working properly – during this test, the detector measures the momentary concentration of the specified gas (rather than the average) and alarms are generated without any delay.



In test mode, the system does not generate any alarms.



Test mode is initiated by approaching a permanent magnet to the detector, the display shows the ‘Ad’ message, the detector address stored in its memory and the ‘tE’ message. Test mode is quitted upon removing of the magnet or within five minutes after test initiation. The location where the magnet is to be approached is shown in Figure 1.

This test is available when the gas detector in operating mode.

For details on how to carry out the test, see Section 7.7.1.



**5.2.2.2 Simulation of alarms**

Simulating alarms allows us to verify that the system is working correctly.

Simultaneously pressing the arrow buttons   (see Figure 1) and holding them down for about one second switches the detector to the configuration mode (the display will show further messages). Releasing the buttons whilst the S1 or S2 message is displayed will enter simulation mode. Releasing the buttons in this state will simulate a sequence of consecutive alarms.

S2 simulation mode is available only for detectors where collaboration with Teta MiniDet detector is enabled (HE = 1). The simulation proceeds in the same way as in S1 (alarms are generated for the Teta MiniDet detector).

The simulation makes it possible to check response of input relays at the control unit. In case of no response or improper operation of the Control Unit it must be inspected with correction of erroneous connections, if any. Contact the equipment manufacturer if the subsequent simulation, after making corrections, is also unsuccessful.

The simulation mode is quitted automatically after the simulation is completed or upon pressing any of the arrow buttons  .

The simulation mode can be used when testing safety functions – see Section 7.7.3.

**6 System architectures**

The gas monitoring systems can be made up of independent gas detector Teta EcoWent or Teta EcoN or coupled and collaborating pairs of detectors (Teta EcoWent / Teta EcoN with Teta MiniDet).

**6.1 Data bus architecture**

In this system gas detectors are connected to the bus via T-connectors S2.

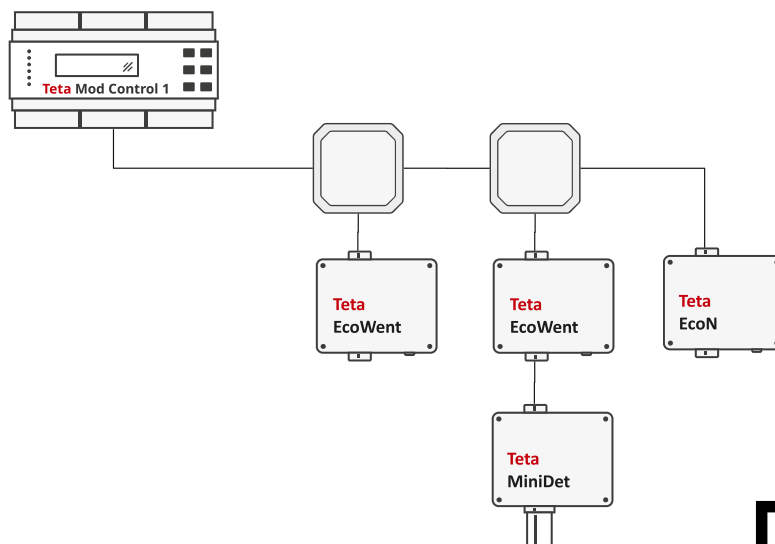


Figure 3: Arrangement of gas detectors according to the data bus architecture

Detailed schematic diagrams in an editable format can be found on our website [tetagas.atestgaz.pl](http://tetagas.atestgaz.pl).



## 7 Lifetime cycle

### 7.1 Transportation






The device can be shipped in the same way as new equipment of that type. If the original package or another protecting means (e.g. corks) is unavailable the conveyed equipment must be secured against shocks, vibrations or moisture by means of adequate methods and material at the own responsibility of the sender.

The device can be conveyed under environmental conditions as described in Table 5.

### 7.2 Installation

#### 7.2.1 Deployment of gas detectors



Deployment of gas detectors must be determined by the system designed with consideration to the following rules:

-  installation of CO detectors is recommended at the height of upper respiratory airways, i.e. circa 1.2 to 1.7 above the floor level,
-  NO<sub>2</sub> detectors should be installed at about 30 cm above the floor,
-  detectors must not be exposed to direct effect of water (moisture) or other chemicals (e.g. cleaning chemicals when the facilities are being cleaned), as well as to direct effect of sunlight, rain or wind,
-  detectors must be secured against damaging mechanical impacts,
-  locations of detectors must enable easy checks and adjustments as well as replacement or disconnection of each detector.

### 7.3 Mechanical mounting of detectors



Mounting of gas detector is allowed only after full completion of all civil engineering works.

-  Spring clamps of terminal blocks are released by depression of the button with a screwdriver.
-  Detectors must be fixed by means of mounting holes that are visible after opening of the housing. Make sure that the gas inlet looks downwards. Dimensions of the housing, arrangement of mounting holes and layout of internal components is shown in Figure 1. Drilling of mounting holes in walls or other permanent structures is easier with use of a drilling pattern attached to the device package.

#### 7.3.1 Electric network



The electric network must be deployed according to the engineering documentation.



The electric system must be designed in conformity to general rules for engineering of A&C<sup>3</sup> systems.



Electric cables and conductors shall be routed in a safe manner to have then protected against possible damage.

If stranded cables are used for deployment of electric lines, ends of cable cores in such cables must be secured by means of clamping bushings (lug).

When two conductors are to be connected to a single terminal clamp of the device they must be encapsulated first within a common clamping bushing (lug) – see details in Table 5.



Do never leave spare lengths of cables inside the device. Bare wires or wires surplus may lead to a hazard of electric shock or equipment damage.



Do never leave redundant cable cores not terminated inside the device.



Incorrect routing of cables may result in impairment of the equipment immunity to electromagnetic interferences.

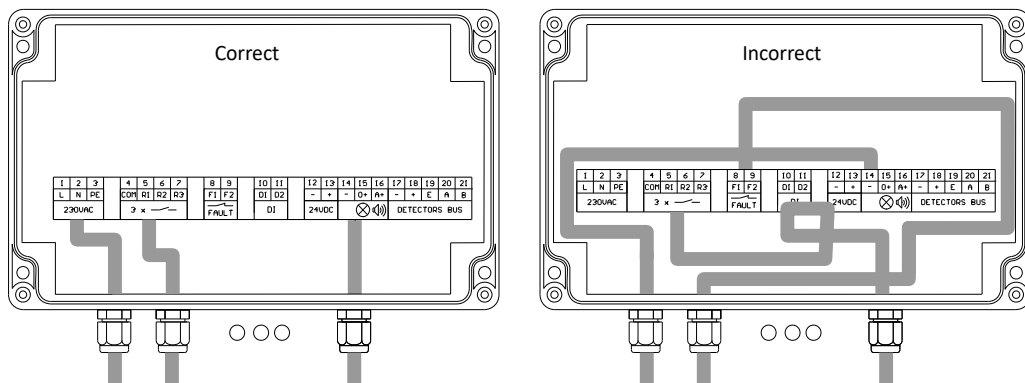


Figure 4: An example of cable termination inside a gas detector






**7.3.2 Types of suitable cables and conductors**

Connection type	Recommended cable type	Example of a suitable cable designation
Connections between T-connectors and gas detectors	Two-core cable	YDY 2 x 1 mm <sup>2</sup>
Connections between Teta EcoWent / Teta EcoN and Teta MiniDet detectors	Three-core cable	YDY 3 x 1 mm <sup>2</sup>

Table 3: Types of suitable cables

## 7.4 Commissioning of the gas monitoring system

After having the electric network complete and power voltage supplied to all devices carry out the following operations:

-  assign addresses to all detectors (see details in section 7.5.1),
-  select the operation mode(s) (see details in section 7.5.2),
-  configure the control unit (see User Manual for the Teta MOD Control 1 Unit [POD-051-ENG](#)),
-  simulate generation of alarms signals S1 (if coupled pairs of gas detectors are included into the system – also the S2 alarm signals) – see details in Section 5.2.2.2,
-  make sure that the system works according to the underlying logic flow chart – execute a test of safety functions – see details in Section 7.7.3.



If any civil engineering or building (finishing) jobs could have been performed yet after installation of the Gas Safety System a test of all detectors is mandatory to make sure that detectors correctly respond to presence of hazardous gases.





In case of improper operation of the system recheck all wiring and connections or contact the system provider /equipment manufacturer.



The gas monitoring system can be approved for operation only after passing results of all aforementioned checks and verifications.





## 7.5 Device configuration

Reliable operation of gas detector needs preliminary configuration of the device parameters. The configuration is performed with the use of two buttons   CONFIG that are available after opening of the device housing (see Figure 1). These buttons enable also displaying of the detector settings.

Information about the detector settings is displayed on side wall of the device housing (see Figure 1).

Alarm thresholds are configured via the control unit – for details, see Section 7.5.3.

### 7.5.1 Assigning addresses to gas detectors



Press the arrow buttons   (see Figure 1) and hold them about one second to enter the mode of configuration assignment (the display will show further messages). Release the buttons with the 'Ad' message active and the message starts blinking slowly – the desired address can now be set by means of the arrow buttons  . Finally, press the both arrow buttons simultaneously to confirm the address and store it into the device (the setting continues blinking for about two seconds). Finally, the device quits the procedure of address assignment.





Should the selected address is not confirmed and stored, the old address remains intact and after 15 seconds the detector quits the mode of address assignment.



The default address is 99.

**7.5.2 Operation modes of gas detectors**

The two possible operation modes can be pre-set:

-  the detector is operating as an independent device,
-  the detector is coupled with the Teta MiniDet device (default setting).

Press the arrow buttons   (see Figure 1) and hold them about two seconds to enter the procedure that enables selection of the operation mode (the ‘HE’ message appears on the device display). Release the buttons with the ‘HE’ message active and the message starts blinking slowly – the desired operation mode can now be set by means of the arrow buttons  . There are two possible options where:

-  0 means independent operation of the detector,
-  1 stands for collaboration with the Teta MiniDet device.

Simultaneous pressing the both buttons confirms the selection and the operation mode is stored in the detector memory (the setting continues blinking for about two seconds). Finally, the device quits the procedure of the operation mode selection.

Omission to confirm the selected operation mode leaves the previous selection intact in the device memory after 15 seconds the detector quits the procedure of operation mode selection.







When the gas detector is configured for independent operation but the Teta MiniDet device is connected anyway, an error message appears (indicated by the LPG LED).

**7.5.3 Configuring alarm thresholds**

Table 5 lists the default alarm threshold values. These thresholds can be changed – for details, see the User Manual for the Teta MOD Control 1 Unit Module ([POD-051-ENG](#)).

**7.5.4 Restoring default alarm thresholds**



Simultaneously pressing the buttons   (see Figure 1) will enter the configuration mode (a series of messages will appear on the display). Releasing the buttons when the message ‘Ld’ is displayed will cause it to flash slowly, giving you the option to:

-  0 – accept the set alarm thresholds,
-  1 – restore the default alarm thresholds (see Table 5).

Confirmation takes place after pressing both buttons (indicated by the setting blinking for about two seconds) and exiting the threshold restoration mode.

**7.6 Troubleshooting**

When a detector reports problems with its operation (see Table 2) the reason for such a behaviour of the device can be identified following guidelines summarized in Table 4.

LED indicator	LED indication	Configuration option	Possible reason for the problem
CO / NO <sub>2</sub>		-	<ul style="list-style-type: none"> <li>• Defect in the measuring path for CO or NO<sub>2</sub></li> <li>• Defective gas sensor</li> </ul>
	 3 cycles 1 cycle	-	<ul style="list-style-type: none"> <li>• Significant exceeding of the sensor range</li> </ul>

LED indicator	LED indication	Configuration option	Possible reason for the problem
LPG		Independent operation of the gas detector	<ul style="list-style-type: none"> <li>Improper setting for the operation mode – see Section 7.5.2</li> </ul>
		Gas detector is coupled with the Teta MiniDet device	<ul style="list-style-type: none"> <li>Defect of Teta MiniDet Gas Detector</li> <li>Improper setting for the operation mode – see Section 7.5.2</li> <li>Improper connection at the location pointed on the schematic below</li> </ul>
		-	<ul style="list-style-type: none"> <li>No requests from the Control Unit – the control unit is configured with insufficient number of gas detectors,</li> <li>Poor quality of electric connection (high level of interferences)</li> <li>Improper power voltage for the detector</li> </ul>
		-	<ul style="list-style-type: none"> <li>Internal defect of the detector</li> </ul>

Table 4: Possible reasons for error signals

### 7.7 Maintenance schedule

When operating a gas monitoring system, it is important to bear in mind that detectors – and particularly the sensors – are components that are susceptible to ageing, wear, and environmental influences. Therefore the systems must undergo regular and scheduled maintenance.

Maintenance operations shall include:

- test with standardized gas – verification test,
- calibration,
- test of safety functions of the entire system,

- replacements of fast-wearing parts.

## 7.7.1 Test with standardized gas – verification test

This test is carried out to verify that the detector is functioning correctly. It involves applying a calibration gas to the sensor and checking its response. The gas test mode can be used to perform this test – see Section 5.2.2.1 for details.

Guidelines for the test with standardized gas – verification test:

- frequency: not less than once a year,
- test gas 1: carbon monoxide, gas concentration should range from the A3 alarm threshold up to 80 % of the measurement range. For instance, when the A3 alarm threshold is 100 ppm, the concentration must range from 100 ppm to 240 ppm,
- test gas 2: nitrogen dioxide, gas concentration should range from the A3 alarm threshold up to 100 % of the measurement range. For instance, when the A3 alarm threshold is 3,6 ppm, the concentration must range from 3,6 ppm to 10 ppm,

Correct execution of the test needs application of a calibration kit with the proper standardized reference gas (see Table 7).



Unauthorized tests of gas detectors when gas with unknown composition and concentration is supplied to the detectors is prohibited. Under such circumstances the gas sensor can be damaged, which leads to loss of the detector calibration.

- gas must be supplied until the detector indication is stabilized (variations below 1 % per 10 s). The readouts should be stabilized not later than in 3 minutes after start of the test. If the stabilization time is longer, the service division of the manufacturer must be consulted,



Supply of the reference gas may activate alarms in the system.

- after the reference gas is supplied, the indication of the detector must be verified (e.g. by reading of the measurement results stored in the control unit). Should the indication error (deviation) exceeds  $\pm 20\%$ , the calibration of the detector is needed. Examples:
  - reference gas concentration is 200 ppm CO and the detector indicated 150 ppm: the relative indication error<sup>4</sup> is -25 %, i.e. the detector response is incorrect and the calibration is needed (in this case absolute indication error<sup>5</sup> is -50 ppm),
  - reference gas concentration is 200 ppm CO and the detector indicated 180 ppm: the indication error is -10,0 % i.e. the detector response is still within the tolerance,
  - reference gas concentration is 200 ppm CO and the detector indicated 220 ppm: the indication error is +10,0 % i.e. the detector response is still within the tolerance,
  - reference gas concentration is 200 ppm CO and the detector indicated 250 ppm: the indication error is +25,0 % i.e. the detector response is incorrect and the calibration is needed,
  - reference gas concentration is 10 ppm NO<sub>2</sub>, and the detector indicated 7 ppm: the indication error is -30,0 % i.e. the detector response is incorrect and the calibration is needed,
  - reference gas concentration is 10 ppm NO<sub>2</sub>, and the detector indicated 9 ppm: the indication

<sup>4</sup> Relative indication error (deviation) = (actual indication – concentration of the reference gas) / concentration of the reference gas.

<sup>5</sup> Absolute indication error = actual indication – concentration of the reference gas.

error is -10,0 % i.e. the detector response is still within the tolerance,

- reference gas concentration is 10 ppm NO<sub>2</sub>, and the detector indicated 12 ppm: the indication error is +20,0 % i.e. the detector response is still within the tolerance,
- reference gas concentration is 10 ppm NO<sub>2</sub>, and the detector indicated 13 ppm: the indication error is +30,0 % i.e. the detector response is incorrect and the calibration is needed.

### 7.7.2 Calibration

Calibration of gas detectors must be entrusted to trained servicemen and the process can be carried out in several ways:

- ✍️ dismount of the complete gas detector and send it to the manufacturer,
- ✍️ removing only sensor plates to send them to the manufacturer for calibration (see Section 7.7.4.1),
- ✍️ contact an authorized service team (e.g. service division of the manufacturer) to come and calibrate the detector on site.

### 7.7.3 Test of safety functions

Execution of the test for safety functions is recommended once a year. Test gas is supplied to one unit of each detector type and response of all components within the Gas Safety System is checked together with all collaborating systems (e.g. ventilation).



During the safety functions test, do not activate the gas test mode (for details, see Section 5.2.2.1). Do not place a magnet against the gas detectors.

Safety functions can be tested using alarm simulations (see Section 5.2.2.2) – however, in this case, we cannot verify that the sensor is functioning correctly. This procedure is recommended for systems where the correct operation of the gas detectors has already been verified (a verification test using a standardized gas, or a recent calibration).

### 7.7.4 Replacement of fast wearing parts

Please refer to Table 6 for the recommended lifetime and replacement schedule of fast wearing parts.

#### 7.7.4.1 Replacement of a sensor plate

Operation of gas detector leads to natural deterioration of metrological parameters of gas sensors. That effect can be compensated by regular and scheduled adjustment of the detector indication up to the moment when the sensor is completely exhausted and must be replaced. It is assumed that replacement of a gas sensor should take place when its sensitivity drops below 50 % of the initial one.

Replacement of a sole sensor is infeasible since it sits on a base plate (sensor plate) and must be replaced together with its plate – see Table 6.

To replace the sensor plate proceed in the following way:


- ✍️ switch off the power voltage for the gas detector,
- ✍️ open the device housing,
- ✍️ replace the sensor plate (see Figure 1),
- ✍️ close the housing,
- ✍️ switch on the power voltage for the gas detector.

**7.7.5 Maintenance**

Gas detectors should be cleaned only by wiping its housing with a soft damp cloth. Cleaning agents containing solvents, white spirit, extraction naphtha or alcohols are not allowed.

The device needs no other maintenance beside cleaning external surface of the housing. These surfaces should be wiped with a soft cloth moistened with water and slight amount of a mild detergent.

**7.8 Disposal**

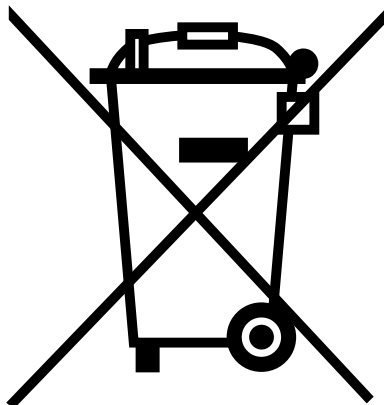

This symbol on a product or on its packaging indicates that the product must not be disposed of with other household waste. Instead, it is the user's responsibility to ensure disposal of waste equipment by handing it over to a designated collection point for the recycling of waste electrical and electronic equipment. The proper recycling of your waste equipment at the time of disposal will help to conserve natural resources and ensure that it is recycled in a manner that protects human health and the environment. Information about relevant designated collection points can be obtained from the Local Authority, waste disposal companies and in the place of purchase. The equipment can also be returned to the manufacturer.

**8 Technical specification**

Power voltage	12 – 50 V $\overline{\text{AC}}$		
<ul style="list-style-type: none"> <li>• <math>V_{CC}</math></li> <li>• Power consumption                             <ul style="list-style-type: none"> <li>• CO / NO<sub>2</sub></li> <li>• CO + LPG</li> </ul> </li> </ul>	0.5 W	1.5 W	
Ambient conditions	Operation		Storage
	-20°C – 50°C 10 % – 90 % long term 0 % – 99 % short term 1013 ± 10 % hPa		0°C – 50°C 30 % – 90 % long term
Monitored gases	Carbon monoxide (CO)	Nitrogen dioxide (NO <sub>2</sub> )	LPG (C <sub>3</sub> H <sub>8</sub> , C <sub>4</sub> H <sub>10</sub> )
Measurement ranges	0 ppm – 300 ppm	0 ppm – 10 ppm	0 % – 50 % LEL
Alarm thresholds range	10 – 95 % of the measurement range		
Default alarm thresholds	A1: 20 ppm A2: 40 ppm A3: 100 ppm	A1: 1.8 ppm A2: 2.7 ppm A3: 3.6 ppm	A1: 10 % LEL A2: 15 % LEL A3: 20 % LEL
Default averaging time A1/A2	5 min		1 min
Default delay time A3	1 min		0 min
Index of protection	IP 43		
Parameters of digital communication	Teta BUS		
Integrated signalling equipment (visual)	LED controls 7-segment LED display		
Protection class	III		
Dimensions	See figure 1		

Cable glands (cable diameter range)	Gland pressed into the installation pipe – diameter of the pipe 16 mm Glands multiband – diameter of wire 3.5 – 12 mm
Acceptable cable cores	0.2 – 2.5 mm <sup>2</sup> – wire cores 0.2 – 2.5 mm <sup>2</sup> – stranded cores
Enclosure material	ABS
Weight	0.3 kg
Lifetime	-
Schedule of mandatory inspections	Every 12 months
Lifetime of fast wearing parts	See Table 6
Mounting	4 holes for screws with the diameters of 4 mm, hole layout – see Figure 1

Table 5: Technical specification

## 9 List of fast wearing parts

No.	Part name	Lifetime	Manufacturer	Product code
{1}	Sensor Board CO	Up to 5 years <sup>6</sup>	Atest Gaz	PWS-017-CO
{1}	Sensor Board NO <sub>2</sub>		Atest Gaz	PWS-017-NO2-10

Table 6: List of fast wearing parts

## 10 List of accessories

Product code	Description
PW-112-S2	T-connector S2
PW-114-A	Mounting kit for Teta EcoWent Gas Detector
PW-114-C	Mounting kit for the set of Teta EcoWent + Teta MiniDet Gas Detectors
PW-064-WM1	WM1 Mounting Bracket (for wall-mounted installation)
PW-092-A	Calibration kit (the set includes: gas supply adapter, hose and cylinder regulator)
-	Standardized reference gas – carbon monoxide CO with concentration of 300 ppm
-	Standardized reference gas – nitrogen dioxide NO <sub>2</sub> with concentration of 10 ppm

Table 7: List of accessories

## 11 Marking codes of products

Product code	Device name
PW-105-CO	Teta EcoWent Gas Detector
PW-111-NO2	Teta EcoN Gas Detector

Table 8: Specification of marking codes for gas detectors

<sup>6</sup> In case of installation in dwelling houses, public access buildings, car parks or garages

## **12 Appendices**



- [1]** DEZG121-ENG – EU Declaration of Conformity – Teta EcoCO2, Teta EcoDet, Teta EcoN, Teta EcoO2, Teta EcoTerm, Teta EcoWent, Teta MiniDet, Teta EcoH
- [2]** PU-Z-032-ENG – Parameters of gas detectors with electrochemical sensor
- [3]** PU-Z-039-ENG – Classification of chemicals used at Atest Gaz

## EU Declaration of Conformity

Atest Gaz A. M. Pachole sp. j. declares with full responsibility, that the product:

(Product description)	(Trade name)	(Type identifier or Product code)
<b>Gas Detector</b>	<b>Teta EcoCO2</b>	<b>PW-133</b>
	<b>Teta EcoDet</b>	<b>PW-106</b>
	<b>Teta EcoN</b>	<b>PW-111</b>
	<b>Teta EcoO2</b>	<b>PW-134</b>
	<b>Teta EcoTerm</b>	<b>PW-113</b>
	<b>Teta EcoWent</b>	<b>PW-105</b>
	<b>Teta MiniDet</b>	<b>PW-107</b>
	<b>Teta EcoH</b>	<b>PW-123</b>

complies with the following Directives and Standards:

-  in relation to Directive 2014/30/EU – on the harmonisation of the laws of the Member States relating to electromagnetic compatibility:
  - EN 50270:2015
-  in relation to directive 2011/65/EU – on the restriction of the use of certain hazardous substances in electrical and electronic equipment
  - EN IEC 63000:2018

This declaration of conformity is issued under the sole responsibility of the manufacturer.

This EU Declaration of Conformity becomes not valid in case of product change or rebuild without manufacturer's permission.

Gliwice, 23.10.2025

Research and Development Manager  
Tomasz Korzec



(Signature)




# Parameters of gas detectors with catalytic sensors

## 1 Detected substances


Detectors equipped with catalytic sensors are used for measuring and detecting the presence of gases and flammable gases in the range of up to 100% LEL.

## 2 Principle of operation

The catalytic sensor (figure 1) consists of two components: an active and a passive one, heated to a high temperature. They are both constructed of a very thin coiled platinum wire, however, the active element (figure 2) is additionally coated with a catalyst (e. g. palladium, platinum). A combustion reaction occurs on the active element. Heat is generated as a result, which causes an increase in the temperature of this element and a resultant change in its resistance. Whereas combustion is not possible on the passive element, therefore, its properties do not change under the influence of a combustible substance. This allows the passive element to compensate for the impact of ambient temperature. The same resistance change of both elements occurs when the ambient temperature changes. The passive and active elements are integrated in the Wheatstone bridge circuit, which ensures conversion of the change of resistance to voltage.

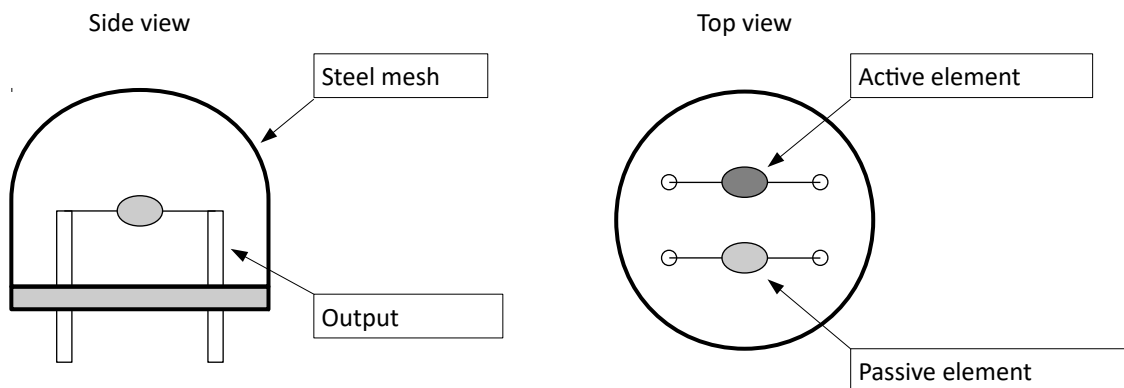

**Figure 1: Sample view of catalytic sensor**

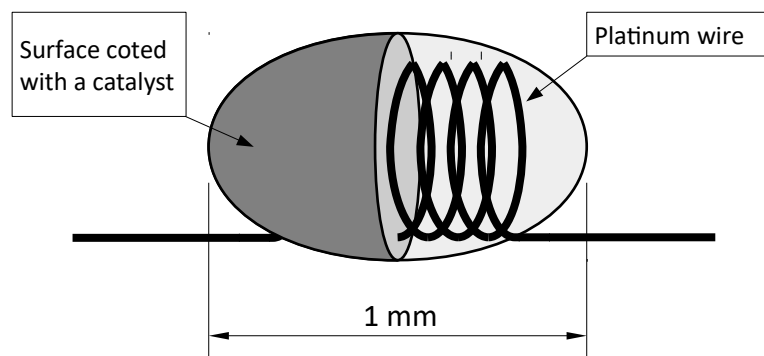

**Figure 2: Active element construction**

### 3 Impact of environmental conditions



Never exceed the rated operating parameters of the detector. These parameters can be found in the detector calibration certificate.



The detector must be used in accordance with the provisions in the User's Manual.

#### 3.1 Composition of the controlled atmosphere

It is assumed that the standard composition of the atmosphere is a mixture of gases with the proportions indicated in table 1.

Ingredient	C [% vol]	C [ppm]
Nitrogen	78.084	780 840
Oxygen	20.946	209 460
Argon	0.934	9 340
Carbon dioxide	0.0360	360
Neon	0.00181	18.18
Helium	0.00052	5.24
Methane	0.00017	1.70
Krypton	0.00011	1.14
Hydrogen	0.00005	0.50
Xenon	0.000008	0.087

**Table 1: Typical composition of atmospheric air**

When gas concentrations in the atmosphere differ significantly from those indicated in the table 1, it is necessary to conduct the analysis of the impact of such a situation on the detector operation.



Catalytic sensor working properly at an oxygen concentration of about 21%.


#### 3.1.1 Impact of the presence of a working gas or other reaction gas

Catalytic sensor isn't selective – it reacts (with different sensitivity) to most flammable substances appearing in its surroundings. Because of that it is necessary to consider their presence when the sensor is operating.

When using detectors with catalytic sensors, it is necessary to be aware that:

- long-term presence of significant concentrations results in faster sensor wear. Basically, catalytic sensors are used to detect the incident presence of combustible gases. They should not work in atmospheres in which flammable gases at concentrations greater than about 20% LEL occur in a continuous or prolonged manner, as it may lead to a rapid reduction of their sensitivity and the appearance of a zero drift,

- / concentrations over 100% LEL, even temporarily persistent ones, can lead to a physical wear of the sensor. For these reasons, detectors operating in places where such conditions may occur are / should be equipped with mechanisms to prevent the negative effects of high concentrations,
- / a very high concentration of combustible gas (well above 100% LEL) leads to a decrease in oxygen concentration – thereby lowering the sensor's indication. Volumetric concentrations close to 100% can result in a zero sensor response, as shown in the figure (example: a small room and a large amount of flammable gas released into the atmosphere). See section 3.1.2.

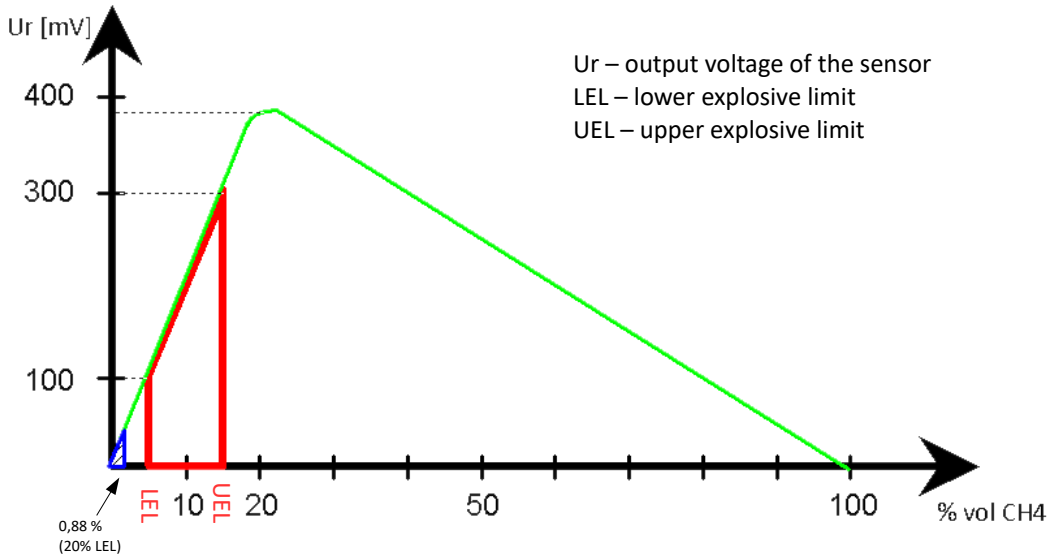

**Figure 3: Sample characteristic of catalytic sensor**

**3.1.2 Effect of oxygen concentration value**

Oxygen is required for a proper operation of the catalytic sensor. If the monitored atmosphere contains gas or gases that dilute or replace air (thereby reducing the oxygen concentration), for example, nitrogen or carbon dioxide, then the catalytic detector can give a low or even zero response.

A similar effect can occur when large amounts of reaction gas are released to the atmosphere (creating a concentration over the measurement range) – due to a too low amount of oxygen, the concentration indication of the detector will be lower than it actually is, and it may even be zero.

**3.2 Influence of temperature**

The temperature can have an influence on the sensor's characteristics. Within the scope of the detector's environmental parameters, its influence is compensated electronically.

**3.3 Influence of pressure**

Within the environmental parameters of the sensor, the influence of pressure on the measurement is negligible.

**3.4 Influence of moisture**

Within the environmental parameters of the sensor the influence of moisture on the measurement is negligible.

### 3.5 Influence of vibrations, impacts

Vibrations and impacts affect the detector's operation, as they may cause:

- damage to delicate parts of the sensor (e. g. detector element, compensation element),
- shift of the sensor's zero.

It should be ensured that the detector is not exposed to shock and vibration in excess of the amplitude of vibrations amounting to 0.15 mm of the frequencies of over 10 Hz. Under no circumstances should the peak acceleration exceed the value of  $19.6 \text{ m/s}^2$ .

### 3.6 Influence of physicochemical phenomena

- In the case of chemical compounds with high flash point (approx.  $50^\circ\text{C}$  and above) it is necessary to remember that in typical environmental conditions (ambient temperature below  $40^\circ\text{C}$ ), it is unlikely that they will be able to produce atmospheres close to 100% LEL. Particularly in the case of ambient temperatures below  $0^\circ\text{C}$  it may occur that achieving measurable concentrations by the catalytic sensor (of 10% LEL) is impossible. Another measurement method is required in this case.
- High concentrations of inserting gases (e. g. argon, helium) can change the thermal equilibrium of the sensor, resulting in the apparent reading of the presence of a combustible substance.

## 4 Factors shortening the lifetime of the sensor

### 4.1 Poison and inhibitors

For every reaction with the presence of a catalyst that cause permanent (poisons) or temporary deceleration (inhibitors) of this reaction, which results in reduced sensor sensitivity – in particular the lack of reaction to a combustible substance.

For catalytic sensors, on the active element side, we distinguish the following poisons:

- silicons (organosilicone compounds) – e. g. PDMS (polydimethylsiloxane), HDMS (hexamethyldisiloxane), sealants, adhesives, raising agents, specific oils and lubricants, some medical supplies,
- organometallic compounds – e. g. Grignard compounds, lead tetrachloride (leaded petrol, certain aviation fuels),
- organophosphorus compounds – e. g. in herbicides, insecticides, phosphoric esters in fire-proof hydraulic fluid,

and inhibitors:

- sulfur compounds – e. g. hydrogen sulfide, mercaptans, carbon disulphide, sulfur dioxide,
- halogen compounds – e. g. methyl chloride, some freons (among others R134a), vinyl chloride,
- olefins – e. g. styrene, propylene, acrylonitrile.

Acetylene is a poison for the passive element of the catalytic sensor.

## Classification of chemicals used at Atest-Gaz

Because of the need to present a **consistent and high level of maintenance services**, to ensure **the safety of the calibration process** and to **create a basis for a rational calculation of the costs** of this process, Atest-Gaz developed the "Classification of Chemical Substances" described below.

The classification determines the complexity of the calibration process of a particular detector type, consider two criteria:

- ✍ stability of the calibration mixture (criterion **A**):
  - ease of generate and its stability,
  - ergonomic complexity of operations,
  - required experience and knowledge of the employee performing the calibration,
  - required equipment,
  - environmental requirements for the process (e.g. weather conditions).
- ✍ safety / potential hazard generated by the mixture (criterion **B**).

These both criteria have an impact on the final cost of the calibration services and level of competence required from the employee conducting the calibration.

This classification is applied both by Atest-Gaz and the entities cooperating with it – distributors, authorized service providers and users of the systems.

In the case of calibration with the "crossover" substances, the classification is made in accordance with the substance category that is applied (e.g. for the detector with a PID sensor this substance is isobutylene, i.e. BO A0).

The detector are classified on the stage of offer.

**On the next page we present tables showing the above relationships.**

Category	Description	Terms of facility calibration
A0	Cylinder gases, stable environment	No precipitations, and no strong winds, and temperature over $-10^{\circ}\text{C}^1$ . In other cases, calibration at a location that meets the above conditions (necessary to remove the detectors).
A1	Cylinder gases, unstable environment or absorption by the moisture	No precipitations, and no strong winds, and temperature over $+10^{\circ}\text{C}^1$ , and relative humidity under 70%. In other cases, calibration at a location that meets the above conditions (necessary to remove the detectors).
A2	Gases not available in cylinders can be generated at the relevant facilities	like <b>A1</b> In other cases, calibration at a location that meets the above conditions (necessary to remove the detectors).
A3	Laboratory calibration	Facility calibration impossible, laboratory calibration only, probably at the manufacturer's. This group also includes conditions resulting from other reasons, e.g. the need for temperature compensation, non-linearity of the sensor, the need for calculation, the use of special tools, etc.

**Table 1. Classification of chemicals used at Atest-Gaz. Criterion A: mixture stability**

Category	Description	Classification criteria
B0	Safe substances	concentration of flammable components $< 60\% \text{ LEL}$ , and concentration of toxic components $\leq \text{NDSch}^2$ , and oxygen concentration $< 25\% \text{ vol}$ , and tank $< 3 \text{ dm}^3$ (water capacity) and $p \leq 70 \text{ atm}$ , or specified liquid chemical compounds, e.g.: glycerol, 1,2-propanediol.
B1	Low-risk substances	concentration of flammable components $< 60\% \text{ LEL}$ , and concentration of toxic components $\leq \text{NDSch}^2$ , and oxygen concentration $< 25\% \text{ vol}$ , and tank $> 3 \text{ dm}^3$ (water capacity) or $p > 70 \text{ atm}$ , or toxic gases with the concentration of $\text{STEL} \div 15 \times \text{NDSch}$ , or specified liquid chemical compounds, e.g.: petrol, acetone, 1-methoxy-2-propanol.
B2	High-risk substances	inert gases having an oxygen concentration $> 25\% \text{ vol}$ , or flammable gases with a concentration $> 60\% \text{ LEL}$ , or specified liquid chemical compounds, e.g.: styrene, methanol, xylene, toluene, methyl methacrylate.
B3	Extremely dangerous or extremely flammable substances	toxic gases with the concentration of $> 15 \times \text{NDSch}^2$ , or specified liquid chemical compounds, e.g.: benzene, formaldehyde, formic acid, epichlorohydrin.

**Table 2. Classification of chemicals used at Atest-Gaz. Criterion B: OHS**

- 1 Is allowed to perform calibrations at lower temperatures, if they meet the conditions of operation of the detector, e.g. ammonia refrigeration units.
- 2 In the absence of determined NDSch it is necessary to adopt  $2 \times \text{NDS}$  as a criterion.







**Atest Gaz A. M. Pachole sp. j.**  
Spokojna 3, 44-109 Gliwice

tel.: +48 32 238 87 94  
fax: +48 32 234 92 71  
e-mail: [contact@atestgaz.pl](mailto:contact@atestgaz.pl)

For more details on our devices and other products and services offered by us, visit:

**[www.atestgaz.pl/en](http://www.atestgaz.pl/en)**